



TEST REPORT

No. : SHMR130605313

Date : June 27,2013

Page: 1 of 3

BEISIT ELECTRIC (HANGZHOU) CO.LTD

1 TANGMEI RD., YUHANG ECONOMIC DEVELOPMENT ZONE, HANGZHOU, ZHEJIANG 311100, CHINA

The following sample(s) was/ were submitted and identified on behalf of the client as:

Sample Name : GABLE GLANDS
Sample No. : SHMR130605313
SGS Ref. No. : SP130603438
Product specification : M25
Material and Mark : Brass
Test Required : IP6K8
Ref. standard : DIN 40050.9-1993
Date of Receipt : June 4,2013
Test Period : June 4,2013 to June 7,2013

Test result(s) : For further details, please refer to the following page(s)

***** To be continued*****

Signed for SGS-CSTC Standards
Technical Services (Shanghai) Co., Ltd

Nikle Ni
Authorized signatory

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and, within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.



8th building, No.69 Block 1159 Kangqiao East Road, Pudong District, Shanghai, China 201319

中国·上海·上海浦东康桥东路1159弄69号8号楼 邮编: 201319

t (86-21) 61196300

t (86-21) 61196300

f (86-21) 68183920

f (86-21) 68183920

www.cn.sgs.com

e sgs.china@sgs.com

Sample Description: High Speed Grounding Kit

Environment Condition: $23 \pm 2^{\circ}\text{C}/50 \pm 5\%\text{RH}$

Sample Quantity: 1 pcs

1. IP6KX

Test Condition:


Test Dust: a mixture of 50% by weight limestone and 50% fly ash with the following particle size distribution: 33 parts by weight $\leq 32\mu\text{m}$; 67parts by weight $>32\mu\text{m}$ but $\leq 250\mu\text{m}$ ($2\text{kg}/\text{m}^3$ chamber volume and be kept in suspension during the test)

Test Duration: 6s movement of the air/dust mixture; pause of 15minutes; 20cycles

Test Result:

Dust ingress was not found inside of the sample after test.

Test Photo:

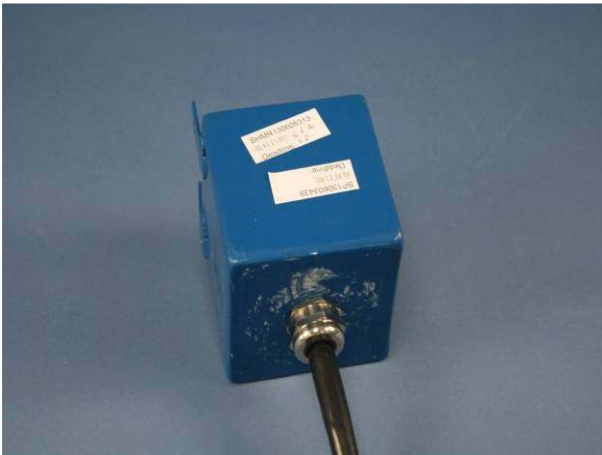

Before Test



After Test

***** To be continued*****

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and, within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

TEST REPORT

No. : SHMR130605313

Date : June 27,2013

Page: 3 of 3



Sample in test

2. IPX8

Test Condition:

Depth: 10m

Test Duration: 8hours

Test Result:

Water ingress was not found inside of the sample after test.

Test Photo:



Before Test



After Test

***** End of report *****

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and, within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.